


REFER TO TANK
DRAWINGS FOR ACTAL
EQUIPMENT LOCATIONS

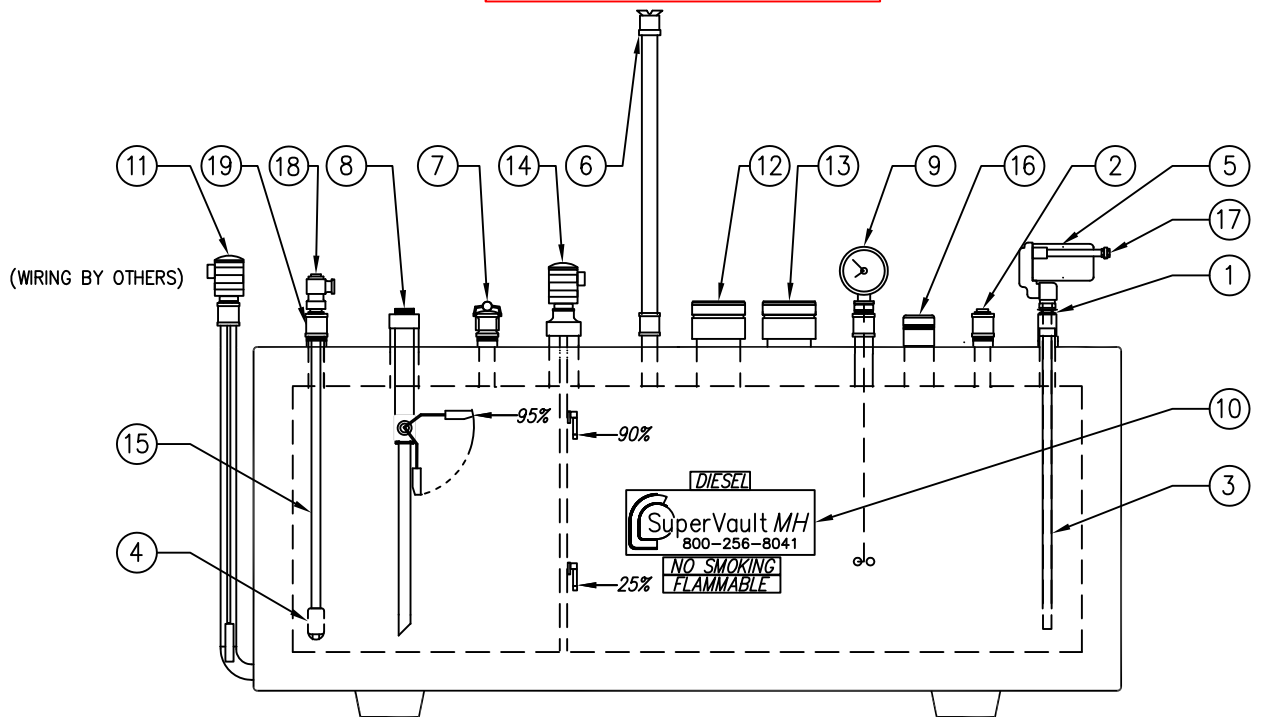

KEYED NOTES

MRK	COMPONENT DESCRIPTION	PART NUMBER
1	ADAPTER BUSHING - 2"x1¼"	FILLRITE ADAPTOR
2	2" RETURN FITTING	SCH 40 PIPE, 2" BLACK
3	1¼" SUCTION TUBE	SCH 40 PIPE, 1" BLACK
4	DOUBLE POPPET FOOT VALVE	FOOT VALVE, 1"
5	TRANSFER PUMP (SUPPLY)	FILLRITE 713V OR 313V
6	UPDRAFT VENT CAP & RISER	MORRISON 354, 2"
7	TOP SEAL ADAPTOR & CAP (STICK PORT)	MORRISON 800F ADAPTOR & 800DC CAP, 2"
8	SHUT-OFF VALVE (PIPE TO GROUND FILL)	CLAY & BAILEY F-35, 3"
9	LEVEL GAUGE	MORRISON CLOCK GAUGE 818, 2"
10	DECAL KIT	PARK/7.305
11	MONITOR TUBE (LEAK CONTACT SWITCH)	PARK CONTROLS
12	PRIMARY EMERGENCY VENT	CLAY & BAILEY 4", 6", OR 8"
13	SECONDARY EMERGENCY VENT	CLAY & BAILEY 4", 6", OR 8"
14	HI/LO LEVEL ALARM SWITCH	PARK CONTROLS
15	TREATMENT (POLISH) SUPPLY	DROP TUBE w/ FOOT VALVE, 1", 1.5", OR 2"
16	SPARE (FOR FUTURE USE)	SCH 40 GALV CAP, 2" OR 4"
17	1" UNION (SUPPLY TO GENERATOR)	SCH 40 PIPE
18	1½" ANTI-SIPHON VALVE	MORRISON 137-1400 AV
19	DOUBLE TAP FITTING	SCH 40 PIPE, 2" X 1" X 1", BLACK

NOTES: PLUGS/CAPS FOR UNUSED NIPPLES

Equipment and Specifications subject to change without notice.

© ParkUSA. ALL RIGHTS RESERVED.

PROJECT:	
CUSTOMER:	
ENGINEER:	
ORDER #:	
PROJECT #:	
DATE:	
TITLE GENERATOR PKG w FR713 TRANSFER PUMP, CLOCK GAUGE HIGH/LOW/LEAK ALARM, TREATMENT SYSTEM (TRANSPORT DELIVERY)	
DATE 04/2018	DWG. NO. GEN4

